

# bautest

Corporation for research and testing of building materials

To determine water impermeability  
After DIN 1048

Order Number: A 362/80

Customer: XYPEX Kemptenerstr. 55, 8900 Augsburg

Water permeable concrete with coating

Part: Coated with Xypex

## General Data

Order from: 26.11.79

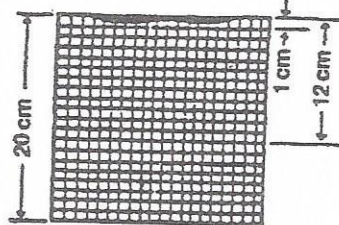
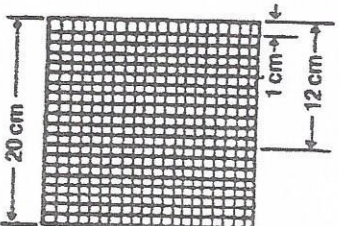
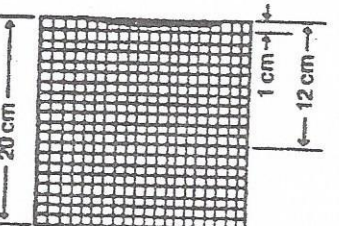
Received: 26.11.79

Type of material to be tested: WU Blocks 20 x 20 x 12 cm

Test date: 18.1.80

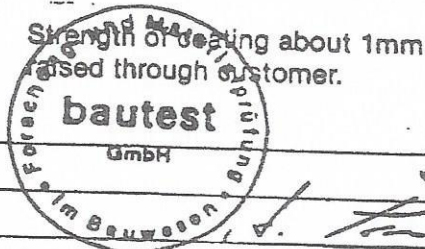
Test submitted: 26.11.79 by Customer

## Testing results

DESCRIPTION	MANUFACTURING DATE	START OF TEST	END OF TEST	LARGEST PENETRATION		REMARKS
1	26.11.79	14.1.80	18.1.80	6		With Coating
2	26.11.79	14.1.80	18.1.80	0		With Coating
3	26.11.79	14.1.80	18.1.80	7		With Coating
				4	<p>Strength of coating about 1mm raised through customer.</p> <p><i>Certified True &amp; Correct</i> <i>Bautest</i></p>	

Augsburg: 25.3.1980

Tests carried out by: Th/Gro



# bautest

Corporation for research and testing of building materials

To determine water impermeability  
After DIN 1048

Order Number: A 362/80

Customer: XYPEX Kemptenerstr. 55, 8900 Augsburg

Water permeable concrete without coating

Part: O - Test untreated

## General Data

Order from: 26.11.79

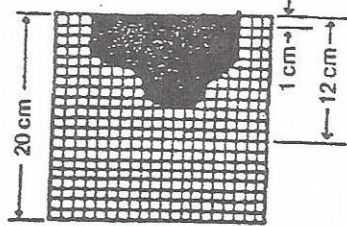
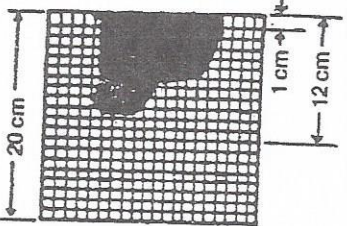
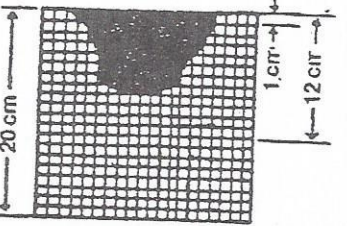
Received: 26.11.79

Type of material to be tested: WU Blocks 20 x 20 x 12 cm


Test date: 18.1.80

Test submitted: 26.11.79

## Testing results

DESCRIPTION	MANUFACTURING DATE	START OF TEST	END OF TEST	LARGEST PENETRATION	REMARKS
3	26.11.79	14.1.80	18.1.80	82	
5	26.11.79	14.1.80	18.1.80	92	
5	26.11.79	14.1.80	18.1.80	78	
				84	Strength of coating about 1mm raised through customer.

*Erstf. Test + Consent  
Bautest*



Augsburg: 25.3.1980

Tests carried out by: Th/Gro

*[Signature]*

Augsbu

Tests cr